



# TX93 Thermocouple Two-Wire Temperature Transmitter

## User's Guide

*Shop online at*

**omega.com<sup>®</sup>**

Ω OMEGA<sup>®</sup>

*omega.com*

*e-mail: info@omega.com*

*For latest product manuals:  
omegamanual.info*



OMEGAnet® On-Line Service  
omega.com

Internet e-mail  
info@omega.com

**Servicing  
North America:**

**U.S.A.:**

ISO 9001 Certified

OMEGA Engineering, Inc., One Omega Drive,

P.O. Box 4047, Stamford, CT 06907-0047 USA

Toll-Free: 1-800-826-6342

TEL: (203) 359-1660

FAX: (203) 359-7700

e-mail: info@omega.com

**Canada:**

976 Bergar

Laval (Quebec), Canada H7L 5A1

Toll-Free: 1-800-826-6342

TEL: (514) 856-6928

FAX: (514) 856-6886

e-mail: info@omega.ca

**For immediate technical or  
application assistance:**

**U.S.A. and Canada:**

Sales Service: 1-800-826-6342/1-800-TC-OMEGA®

Customer Service: 1-800-622-2378/1-800-622-BEST®

Engineering Service: 1-800-872-9436/1-800-USA-WHEN®

**Mexico:**

En Español: 001 (203) 359-7803

FAX: (001) 203-359-7807

e-mail: info@omega.com.mx

espanol@omega.com

## Servicing Europe:

### Benelux:

Managed by the United Kingdom Office  
Toll-Free: 0800 099 3344 TEL: +31 20 347 21 21  
FAX: +31 20 643 46 43 e-mail: sales@omega.nl

### Czech Republic:

Frystatska 184, 733 01 Karviná, Czech Republic  
Toll-Free: 0800-1-66342 TEL: +420-59-6311899  
FAX: +420-59-6311114  
e-mail: info@omegashop.cz

### France:

Managed by the United Kingdom Office  
Toll-Free: 0800 466 342 TEL: +33 (0) 161 37 29 00  
FAX: +33 (0) 130 57 54 27 e-mail: sales@omega.fr

### Germany/Austria:

Daimlerstrasse 26  
D-75392 Deckenpfronn, Germany  
Toll-Free: 0 800 6397678 TEL: +49 (0) 7059 9398-0  
FAX: +49 (0) 7056 9398-29 e-mail: info@omega.de

### United Kingdom: ISO 9001 Certified

OMEGA Engineering Ltd.  
One Omega Drive, River Bend Technology  
Centre, Northbank, Irlam, Manchester  
M44 5BD England  
Toll-Free: 0800-488-488  
TEL: +44 (0)161 777-6611  
FAX: +44 (0)161 777-6622  
e-mail: sales@omega.co.uk

It is the policy of OMEGA Engineering, Inc. to comply with all worldwide safety and EMC/EMI regulations that apply. OMEGA is constantly pursuing certification of its products to the European New Approach Directives. OMEGA will add the CE mark to every appropriate device upon certification. The information contained in this document is believed to be correct, but OMEGA accepts no liability for any errors it contains, and reserves the right to alter specifications without notice.

**WARNING:** These products are not designed for use in, and should not be used for, human applications.

## RETURN REQUESTS / INQUIRIES

Direct all warranty and repair requests/inquiries to the OMEGA Customer Service Department. BEFORE RETURNING ANY PRODUCT(S) TO OMEGA, PURCHASER MUST OBTAIN AN AUTHORIZED RETURN (AR) NUMBER FROM OMEGA'S CUSTOMER SERVICE DEPARTMENT (IN ORDER TO AVOID PROCESSING DELAYS). The assigned AR number should then be marked on the outside of the return package and on any correspondence. The purchaser is responsible for shipping charges, freight, insurance and proper packaging to prevent breakage in transit.

FOR **WARRANTY** RETURNS, please have the following information available BEFORE contacting OMEGA:

1. Purchase Order number under which the product was PURCHASED,
2. Model and serial number of the product under warranty, and
3. Repair instructions and/or specific problems relative to the product.

FOR **NON-WARRANTY** REPAIRS, consult OMEGA for current repair charges. Have the following information available BEFORE contacting OMEGA:

1. Purchase Order number to cover the COST of the repair,
2. Model and serial number of the product, and
3. Repair instructions and/or specific problems relative to the product.

OMEGA's policy is to make running changes, not model changes, whenever an improvement is possible. This affords our customers the latest in technology and engineering. OMEGA is a registered trademark of OMEGA ENGINEERING, INC.

© Copyright 2008 OMEGA ENGINEERING, INC. All rights reserved. This document may not be copied, photocopied, reproduced, translated, or reduced to any electronic medium or machine-readable form, in whole or in part, without the prior written consent of OMEGA ENGINEERING, INC.



## Unpacking Instructions

---

Remove the Packing List and verify that you have received all equipment, including:

- TX93 Termocouple Two-Wire Temperature Transmitter
- Operator's Manual

If you have any questions about the shipment, please call the Customer Service Department.

When you receive the shipment, inspect the container and equipment for signs of damage. Note any evidence of rough handling in transit. Immediately report any damage to the shipping agent.

---

**NOTE**

The carrier will not honor damage claims unless all shipping material is saved for inspection. After examining and removing contents, save packing material and carton in the event reshipment is necessary.

---

**TX93**

**Thermocouple Two-Wire Temperature Transmitter**

---



**TABLE OF  
CONTENTS**

<b>Section</b>	<b>Page</b>
<b>Section 1 Introduction</b>	<b>1</b>
<b>Section 2 Installation</b>	<b>11</b>
2.1 Mounting the TX93 .....	11
2.2 Wiring the TX93 .....	17
<b>Section 3 Calibration Instructions</b>	<b>19</b>
3.1 Equipment Required .....	19
3.2 Set-up of Equipment .....	20
3.3 Calibration Procedures .....	21

<b>Section</b>	<b>Page</b>
<b>Section 4 Troubleshooting Guide</b>	<b>27</b>
<b>Section 5 Accessories</b>	<b>30</b>
<b>Section 6 Specifications</b>	<b>31</b>

## 1.1 General Description

The OMEGA® TX93 Thermocouple Two-Wire Temperature Transmitter accepts thermocouple sensor types J, K, T, or E and will produce a standard 4-20 mA output signal proportional to that produced by its attached input temperature sensor. Transmission of the proportional current output may be accomplished by using inexpensive copper wire.

# 1

## Introduction



Figure 1-1 TX93 Transmitter

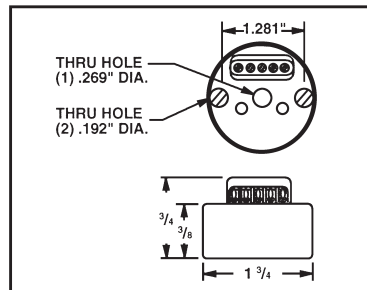


Figure 1-2 Dimensions (in inches)

The TX93 transmitter is normally powered by an unregulated power supply as shown in Figure 1-3. The proportionally-transmitted signal begins at 4 mA, at the low end of its temperature range, and increases to 20 mA, at the high end of its temperature range. (There are various temperature ranges thermocouple types available for the TX93. To order, refer to Section 1.3 for correct Model Numbers and Range Codes.)

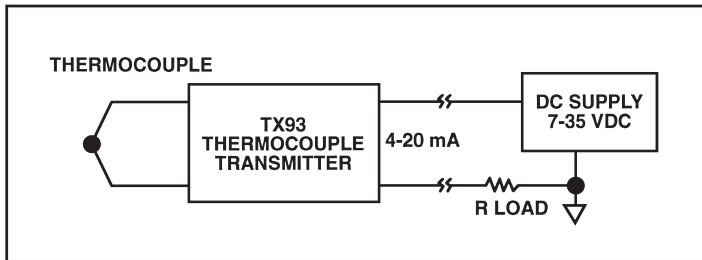


Figure 1-3 TX93 Thermocouple Transmitter

The TX93 two-wire transmitter receives and measures signals from thermocouples and sends an output current of 4-20 mA which is directly proportional to the thermocouple millivolt input. It is designed to connect with only two copper wire leads that will supply the voltage to operate the transmitter from a power supply, and also carry the output current. The output current is used for recording, computing, or controlling.

If the TX93 is mounted inside a protection head, (see Figure 3-1), the thermocouple extension wires are replaced by two copper wires that carry the 4-20 mA signal and dc voltage to operate the transmitter.

The TX93 has reverse supply polarity protection and will operate with a wide range of supply voltages (7 to 35 Vdc). It has an input sensor break-protection circuit that forces the output current to go upscale when the thermocouple wire opens. It also is provided with a screw terminal, where the output current can be measured without interrupting the power loop. The TX93 does NOT provide isolation between its input and the 4-20 mA output; therefore, an ungrounded thermocouple junction is suggested to prevent possible ground loops. Note that most thermocouple transmitters with 4-20 mA outputs, including the TX93, are proportional with respect to the thermocouple input voltage. However, the relationship between temperature and millivolt for all the thermocouple types is somewhat non-linear.

This leads to maximum error at approximately the midpoint of the range as shown in Figure 1-4.

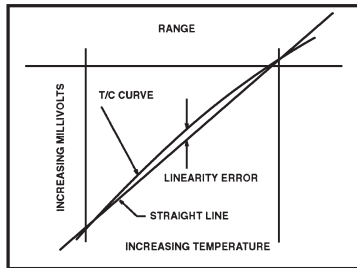


Figure 1-4 Straight Line Approximation of a Curve



## Introduction

---

### 1.2 Features

- 4-20 mA output
- $\pm 0.1\%$  full-scale accuracy (with respect to the mV input signal)
- Upscale break protection
- Low Cost

## 1.3 Models Available

Table 1-1. Range Code

<b>RANGE</b>	<b>INPUT TYPES</b>			
	<b>J</b>	<b>K</b>	<b>T</b>	<b>E</b>
-40 to 120°F	J1	–	–	E1
0 to 200°F	J2	K2	T2	E2
0 to 300°F	J3	K3	T3	E3
0 to 500°F	J4	K4	T4	E4
0 to 750°F	J5	K5	T5	E5
0 to 1000°F	J6	K6	–	E6

## TX93 Models Available

Model Number	Description
TX93-(*)	Thermocouple Transmitter (J, K, T, or E)
NB1TX93-(*)	NB1 thermocouple probe, 12" L, 1/4" O.D., ungrounded junction, 304SS sheath

\*Insert range code from Table 1-1

For complete information on NB1 Thermocouple probes, see the OMEGA Temperature Measurement Handbook®.

### **3.1 Mounting the TX93**

The TX93 transmitter may be:

1. surface mounted,
2. mounted inside a protection head (refer to Figure 2-1), or
3. installed into the OMEGA mounting track (part number RT) using an OMEGA mounting bracket (part number TX90-BR).
4. installed into standard 35mm DIN rail using an OMEGA DIN rail mounting adapter (part number TX-90-DIN).

Figure 2-2 shows the RT mounting track. Figure 2-3 shows the TX90-BR mounting bracket.

Figure 2-4 shows a typical installation using the bracket and mounting track. Figure 2-5 shows the TX90-DIN adapter.



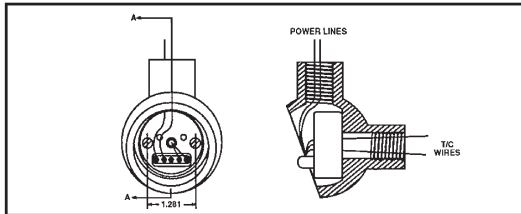


Figure 2-1 Assembly of the Transmitter inside an OMEGA NB1 Protection Head (Dimensions in inches)

**CAUTION**

Hand tighten transmitter mounting screws only. Do not overtighten.

Figure 2-2 RT Mounting Track (Dimensions in inches)

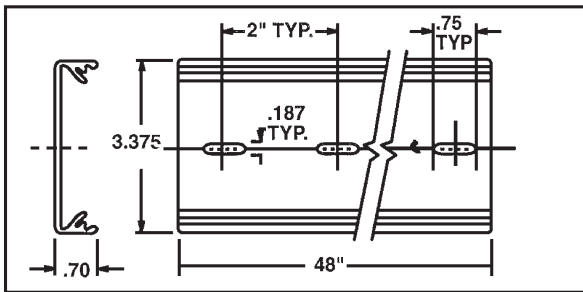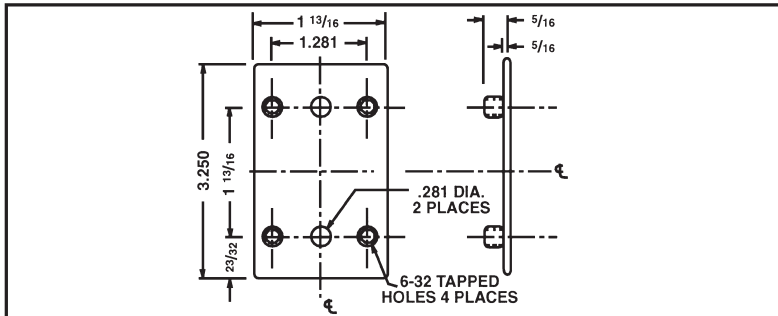

14 Figure 2-3 TX90-BR Mounting Bracket (Dimensions in inches)

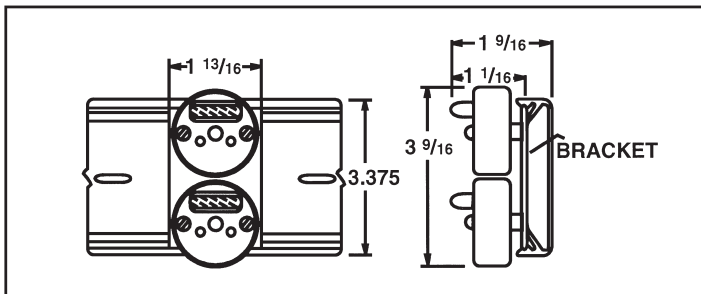


Figure 2-4 Installation with the Bracket and Track (Dimensions in inches)

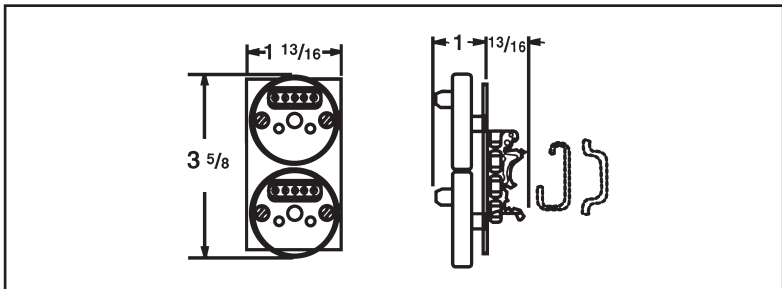


Figure 2-5 TX 90-DIN DIN Rail Mounting Adapter (in Inches)

---

## 2.2 Wiring the TX93 (Refer to Figure 2-6)

1. Connect a dc power supply in series with the load to the (+PS) and (-PS) power terminals. Note that the load (usually a monitoring instrument) may be connected to either the (+) or (-) power lead.
2. Connect the thermocouple to the (+IN) and (-IN) input terminals.

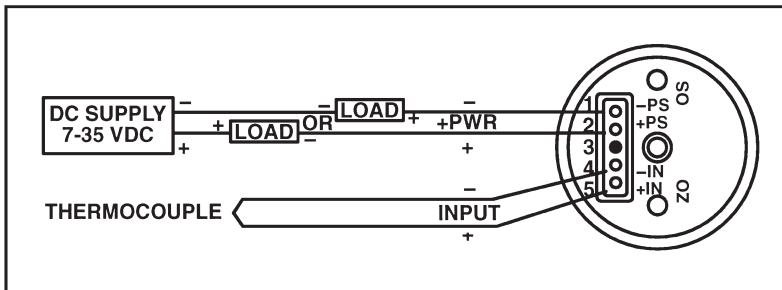


Figure 2-6 Wiring Diagram for the TX 93

### 3.1 Equipment Required

- Precision mV source, with 0.001 mV resolution and  $\pm 0.002$  mV accuracy or
- Precision DVM with  $\pm 0.002$  mV accuracy and an adjustable mV source with 0.001 mV resolution
- OMEGA TRC III Ice Point Reference (or stable ice bath)
- Temperature Reference Probe (OMEGA P/N: TRP-\*)  
\*Thermocouple Type J, K, T, E

## **3.2 Set-Up of Equipment**

To prepare the ice bath:

- a) Fill a glass beaker with crushed ice made from distilled water.
- b) Fill the beaker with enough distilled water so that the ice just becomes slush, but not enough to float the ice.
- c) Insert the reference thermocouple.

Figure 3-2 shows an alternate set-up. Here, a high precision thermocouple calibrator, such as the OMEGA Model CL511, replaces the DVM, ice bath, voltage source, etc.

### 3.3 Calibration Procedures (Refer to Figure 3-1)

Connect the calibration equipment according to Figure 3-1 or 3-2. The thermocouple wire must be of the same calibration as the transmitter being calibrated. Make sure that the wiring polarities are correct. (Note that the RED thermocouple wire is NEGATIVE).

To check or adjust the calibration:

1. Locate the Z (zero) and S (span) potentiometers.
2. Select, from Table 3-1, the correct mV input values for the Z (zero) and S (span) adjustments that correspond to the model number. For example, for Model TX93-J2, the Z input is -0.886 mV, and the S input is 4.907 mV.

If a Thermocouple Calibrator/Simulator is used, such as the OMEGA Model CL511 Precision Calibrator, select the Temperature Input Z (zero) and S (span) values.

3. Set the dc mV source to the selected Z (zero) mV value. Adjust the Z potentiometer to read 4.000 mA on the monitoring instrument.
4. Set the dc mV source to the selected S (span) mV value. Adjust the S potentiometer to read 20.000 mA on the monitoring instrument.
5. Repeat steps 3 and 4, as required, until the readings are exactly 4.000 mA and 20.000 mA. This procedure is necessary since there is interaction between the two potentiometers.

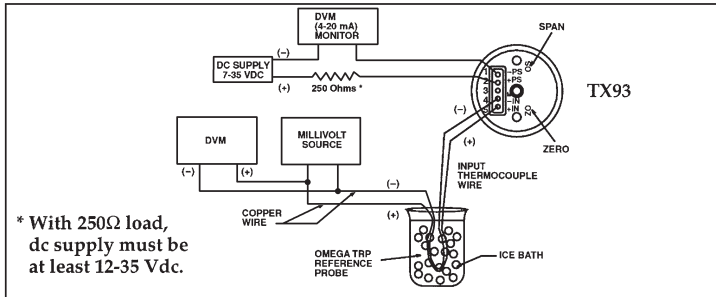


Figure 3-1 TX93 Calibration Set-Up

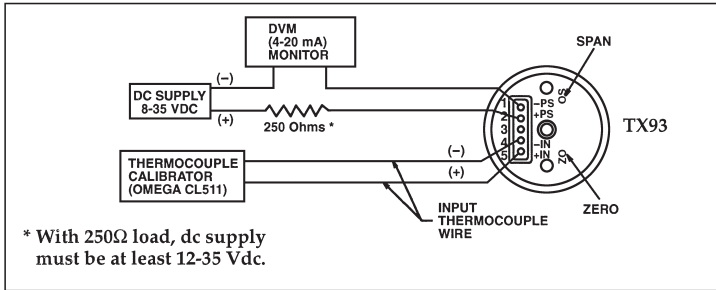


Figure 3-2 TX93 Calibration Set-Up (Alternate)

Table 3-1. Calibration Values for the TX93

Temperature Input Range Zero/Span	Model TX93	mV Input Ref 32°F Zero/Span	Model TX93	mV Input Ref 32°F Zero/Span
-40/120°F	-J1	-1.961/2.527	–	–
0/ 200°F	-J2	-0.886/4.907	-K2	-0.692/3.820
0/ 300°F	-J3	-0.886/7.949	-K3	-0.692/6.094
0/ 500°F	-J4	-0.886/14.110	-K4	-0.692/10.561
0/ 750°F	-J5	-0.886/21.787	-K5	-0.692/16.350
0/1000°F	-J6	-0.886/29.521	-K6	-0.692/22.255

Table 3-1. Calibration Values for the TX93 (Continued)

Temperature Input Range Zero/Span	Model TX93	mV Input Ref 32°F Zero/Span	Model TX93	mV Input Ref 32°F Zero/Span
-40/120°F	-	-	-E1	-2.255/2.977
0/ 200°F	-T2	-0.675/3.968	-E2	-1.026/5.871
0/ 300°F	-T3	-0.675/6.648	-E3	-1.026/9.710
0/ 500°F	-T4	-0.675/12.574	-E4	-1.026/17.945
0/ 750°F	-T5	-0.675/20.803	-E5	-1.026/28.857
0/1000°F	-	-	-E6	-1.026/40.064

Malfunction or incorrect operation may be caused by:

1. Reversed polarity:

Check the wiring using Figure 2-6 as a guide. If the temperature of the thermocouple increases while the current magnitude decreases, the problem could be caused by reversed polarity of the:

- a) thermocouple wiring
- b) power supply leads
- c) monitor instrument

2. Loose or broken wires:

Check each terminal connection for tightness. Move each wire back and forth and note any changes in operation.

3. Too high a load resistance in the output current loop or too low a current rating on the power supply:

- a) Measure the total resistance of each device (excluding the transmitter and power supply) in the 20 mA loop, including the resistance of the lead wires.

- b) Calculate maximum allowable loop resistance using the formula: 
$$\text{Loop Resistance (maximum)} = \frac{V_{\text{supply}} - 7V}{0.020A}$$

For example, a 24V power supply would give a maximum loop resistance of:  $17V / 0.020A = 850$  ohms.

- c) Make sure the power supply is rated for at least 28 mA times the number of TX93 transmitters being powered. For example, if the supply is powering five transmitters, the supply should be rated for at least 140 mA.

<b>Model No.</b>	<b>Description</b>
TX90-BR	Mounting Bracket
PSU-24B	Unregulated Power Supply, 24 Volts
TX82B	Process Loop-Powered Indicator
RT	48" Mounting Track
TX90-DIN	DIN Rail Mounting Adapter
RAIL-35-2	6.5' Section 35mm DIN Rail

---

### General

---

Size:	1.75" dia. X 0.75" high (includes terminal strip)
Zero/Span Adjustment	
Range:	$\pm 25\%$
Power Supply Voltage	
Operating Range:	+7 Vdc to +35 Vdc, 28 mA max required per transmitter
Accuracy:	$\pm 0.1\%$ of full scale (includes effects of hysteresis, repeatability and linearity proportional to the T/C)
Frequency Response:	3dB@ 3Hz

Ambient Temperature:	-13°F to 185°F (-25°C to 85°C)
Storage Temperature Range:	-85°F to 257°F (-65°C to 125°C)
Thermal Zero Shift:	<0.01%/°F of span (span >10 mV) <0.02%/°F of span (4-10 mV span)
Thermal Span Shift:	<0.01%/°F of span
Weight:	1.0 oz (28g)

---

**Output**

---

Current Output Span:	4-20 mA dc
Current Output Limits:	3 to 28 mA, typical

Maximum Loop

Resistance:  $(V_{\text{supply}} - 7V)/0.020A = \text{ohms}$

Load Resistance Effect: 0.01% of span per 300 ohms change

Power Supply Effect: 0.002% of output span per volt

---

## Input

---

Sensor: Thermocouple

Input Break Protection: Upscale

Impedance:  $>30 \text{ M}\Omega$

Source Current: 4 mA typical







## Notes

---



## WARRANTY/DISCLAIMER

OMEGA ENGINEERING, INC. warrants this unit to be free of defects in materials and workmanship for a period of **13 months** from date of purchase. The OMEGA® WARRANTY adds an additional one (1) month grace period to the normal **one (1) year product warranty** to cover handling and shipping time. This ensures that OMEGA's customers receive maximum coverage on each product.

If the unit malfunctions, it must be returned to the factory for evaluation. OMEGA's Customer Service Department will issue an Authorized Return (AR) number immediately upon phone or written request. Upon examination by OMEGA, if the unit is found to be defective, it will be repaired or replaced at no charge. OMEGA's WARRANTY does not apply to defects resulting from any action of the purchaser, including but not limited to mishandling, improper interfacing, operation outside of design limits, improper repair, or unauthorized modification. This WARRANTY is VOID if the unit shows evidence of having been tampered with or shows evidence of having been damaged as a result of excessive corrosion; or current, heat, moisture or vibration; improper specification; misapplication; or misuse or other operating conditions outside of OMEGA's control. Components in which wear is not warranted, include but are not limited to contact points, fuses, and triacs.

**OMEGA is pleased to offer suggestions on the use of its various products. However, OMEGA neither assumes responsibility for any omissions or errors nor assumes liability for any damages that result from the use of its products in accordance with information provided by OMEGA, either verbal or written. OMEGA warrants only that the parts manufactured by the company will be as specified and free of defects. OMEGA MAKES NO OTHER WARRANTIES OR REPRESENTATIONS OF ANY KIND WHATSOEVER, EXPRESSED OR IMPLIED, EXCEPT THAT OF TITLE, AND ALL IMPLIED WARRANTIES INCLUDING ANY WARRANTY OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE ARE HEREBY DISCLAIMED. LIMITATION OF LIABILITY: The remedies of purchaser set forth herein are exclusive, and the total liability of OMEGA with respect to this order, whether based on contract, warranty, negligence, indemnification, strict liability or otherwise, shall not exceed the purchase price of the component upon which liability is based. In no event shall OMEGA be liable for consequential, incidental or special damages.**

CONDITIONS: Equipment sold by OMEGA is not intended to be used, nor shall it be used: (1) as a "Basic Component" under 10 CFR 21 (NRC), used in or with any nuclear installation or activity; or (2) in medical applications or used on humans. Should any Product(s) be used in or with any nuclear installation or activity, medical application, used on humans, or misused in any way, OMEGA assumes no responsibility as set forth in our basic WARRANTY/DISCLAIMER language, and, additionally, purchaser will indemnify OMEGA and hold OMEGA harmless from any liability or damage whatsoever arising out of the use of the Product(s) in such a manner.

# Where Do I Find Everything I Need for Process Measurement and Control? **OMEGA...Of Course!**

*Shop online at [omega.com](http://omega.com)<sup>SM</sup>*

## **TEMPERATURE**

- ☑ Thermocouple, RTD & Thermistor Probes, Connectors, Panels & Assemblies
- ☑ Wire: Thermocouple, RTD & Thermistor
- ☑ Calibrators & Ice Point References
- ☑ Recorders, Controllers & Process Monitors
- ☑ Infrared Pyrometers

## **PRESSURE, STRAIN AND FORCE**

- ☑ Transducers & Strain Gages
- ☑ Load Cells & Pressure Gages
- ☑ Displacement Transducers
- ☑ Instrumentation & Accessories

## **FLOW/LEVEL**

- ☑ Rotameters, Gas Mass Flowmeters & Flow Computers
- ☑ Air Velocity Indicators
- ☑ Turbine/Paddlewheel Systems
- ☑ Totalizers & Batch Controllers

## **pH/CONDUCTIVITY**

- ☑ pH Electrodes, Testers & Accessories
- ☑ Benchtop/Laboratory Meters
- ☑ Controllers, Calibrators, Simulators & Pumps
- ☑ Industrial pH & Conductivity Equipment

## **DATA ACQUISITION**

- ☑ Data Acquisition & Engineering Software
- ☑ Communications-Based Acquisition Systems
- ☑ Plug-in Cards for Apple, IBM & Compatibles
- ☑ Data Logging Systems
- ☑ Recorders, Printers & Plotters

## **HEATERS**

- ☑ Heating Cable
- ☑ Cartridge & Strip Heaters
- ☑ Immersion & Band Heaters
- ☑ Flexible Heaters
- ☑ Laboratory Heaters

## **ENVIRONMENTAL MONITORING AND CONTROL**

- ☑ Metering & Control Instrumentation
- ☑ Refractometers
- ☑ Pumps & Tubing
- ☑ Air, Soil & Water Monitors
- ☑ Industrial Water & Wastewater Treatment
- ☑ pH, Conductivity & Dissolved Oxygen Instruments

M2225/0709